

Appendix B

Hunterville Maps

Appendix B Figures List

Figure	Description
1.1.1	Hunternville Existing Water Supply Network Performance
1.1.2	Hunternville Existing Fire Flow (FW2) Assessment
1.2.1	Hunternville Existing Wastewater Network - Dry Weather Flow
1.2.2	Hunternville Existing Wastewater Network - Wet Weather Flow
1.3	Hunternville Stormwater Rapid Flood Hazard Assessment

Hunternville Status Quo PDD

■ Hunternville Reservoirs

Hunternville Status Quo PDD


Minimum Pressure (m)

- < 0
- >= 0
- >= 10
- >= 20
- >= 25
- >= 60

Maximum Headloss per km (m/km)

- >= 0
- >= 3
- >= 5
- >= 10
- >= 25

Hunternville Reservoirs

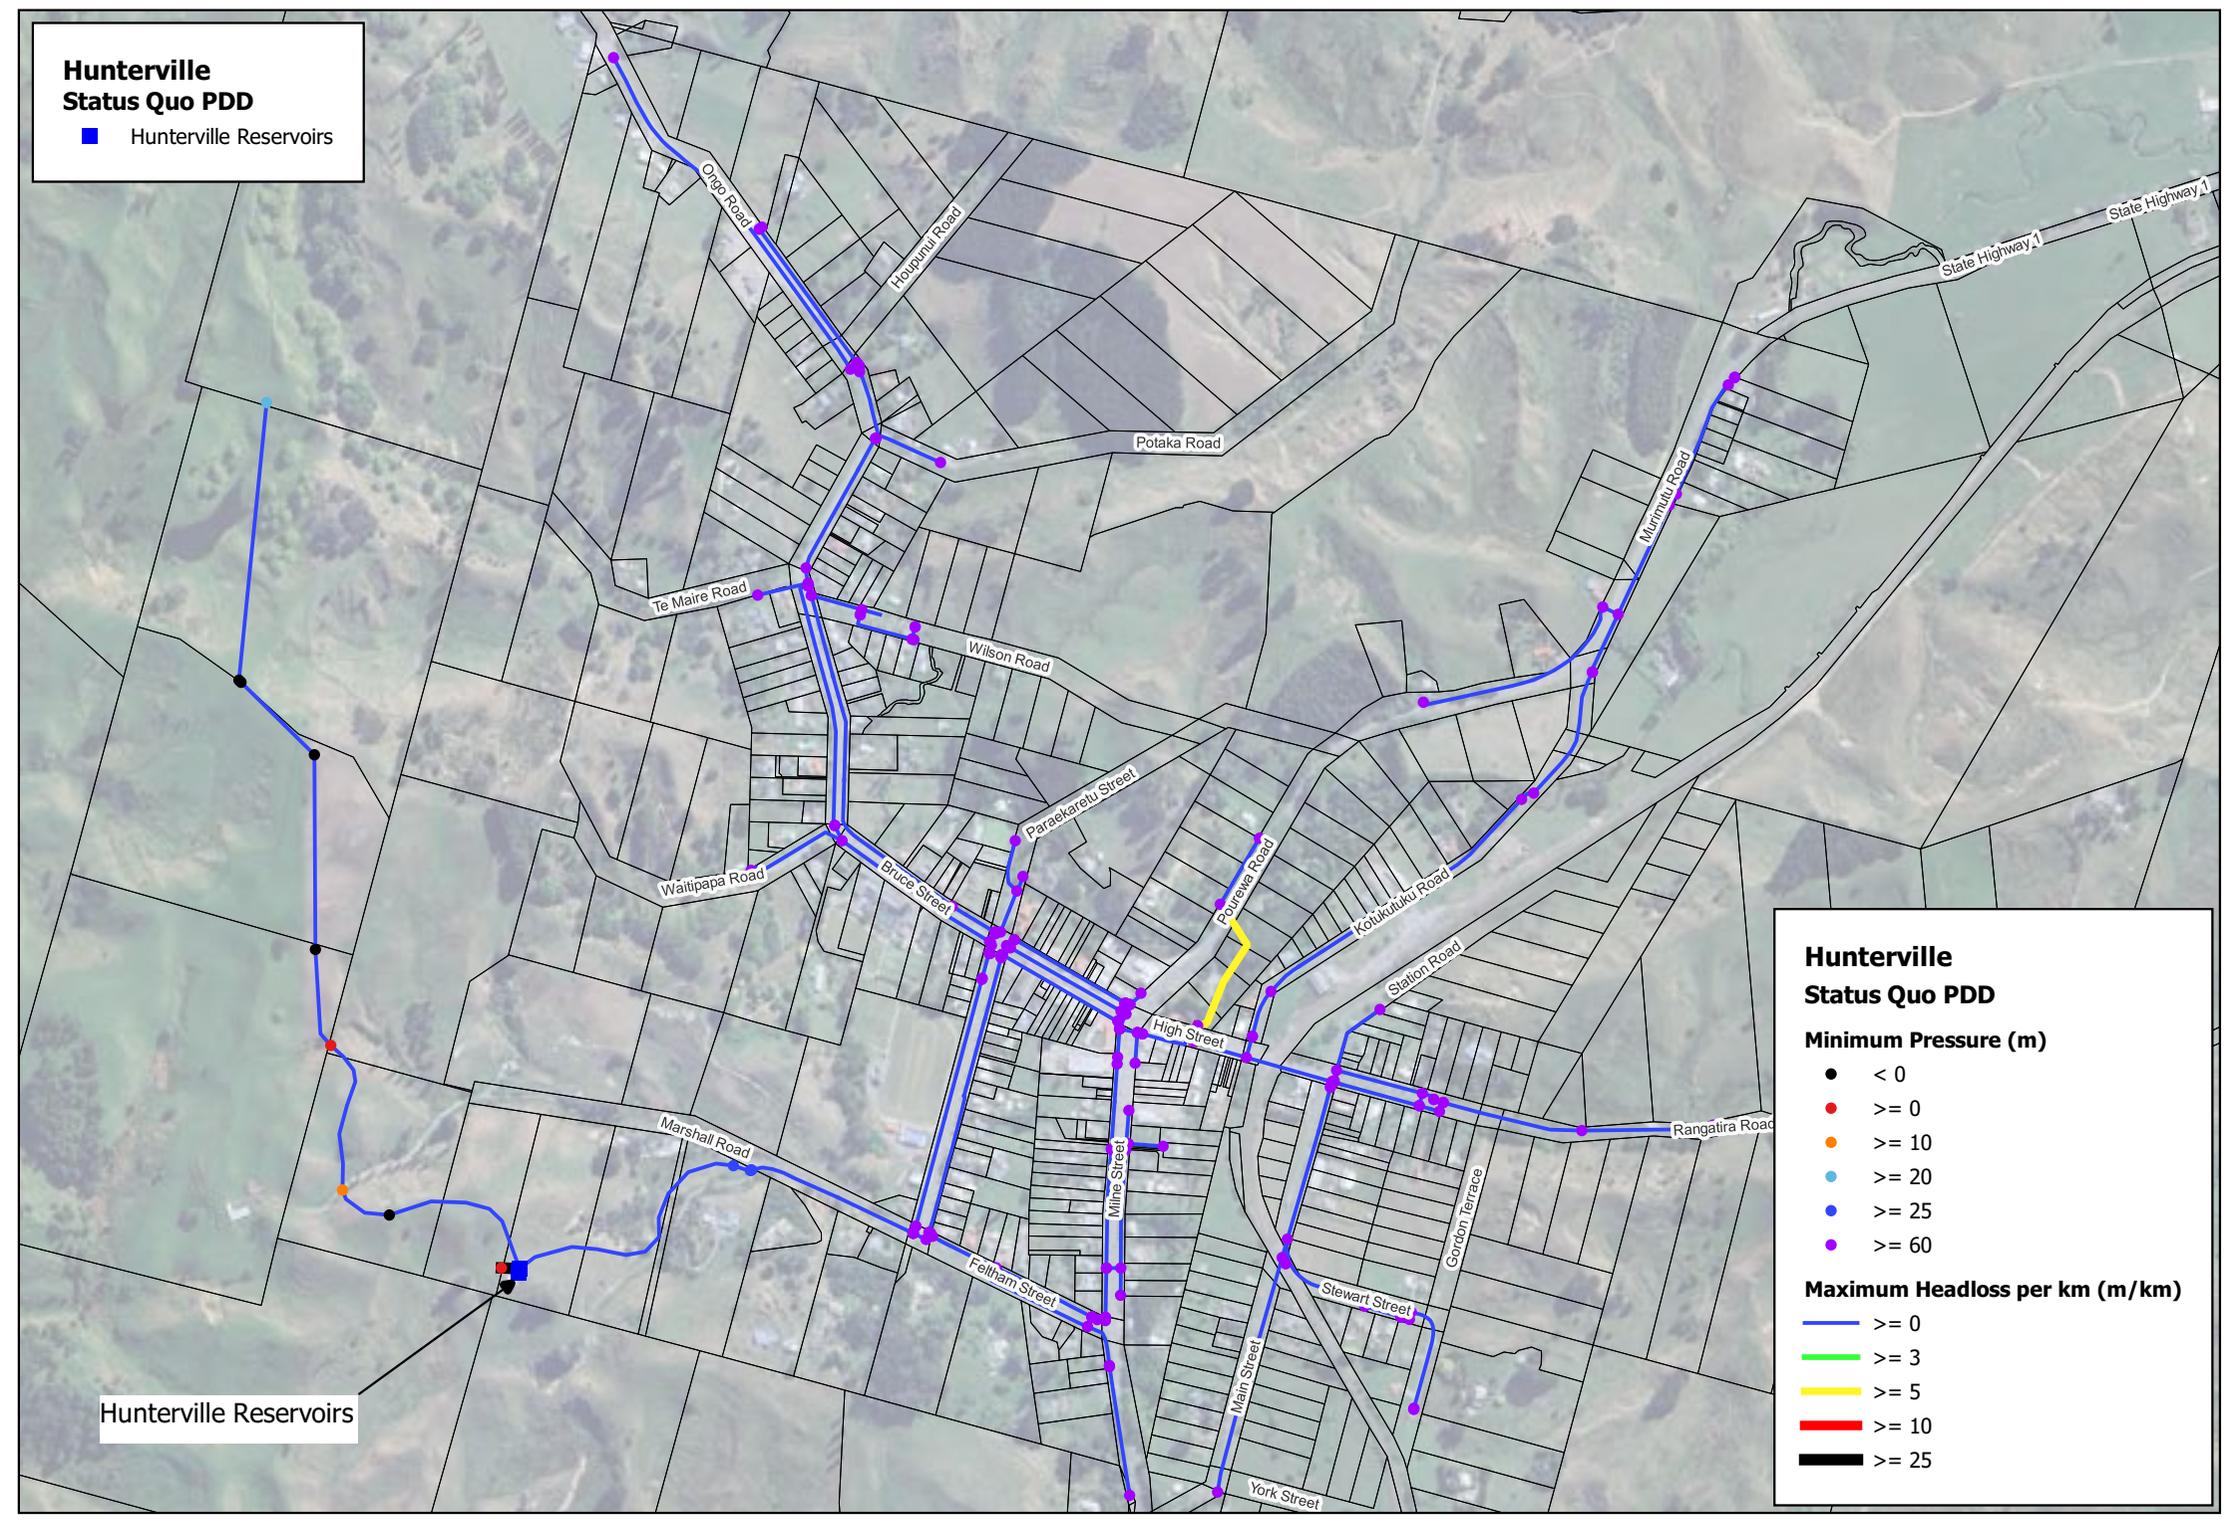

Huntermville Existing Network Fire Flow

■ Huntermville Reservoirs


Huntermville Existing Network Fire Flow


— Huntermville Main

Available Fire Flow (l/s)

- > 0
- >= 12.5
- >= 20
- >= 25

Huntermville Reservoirs

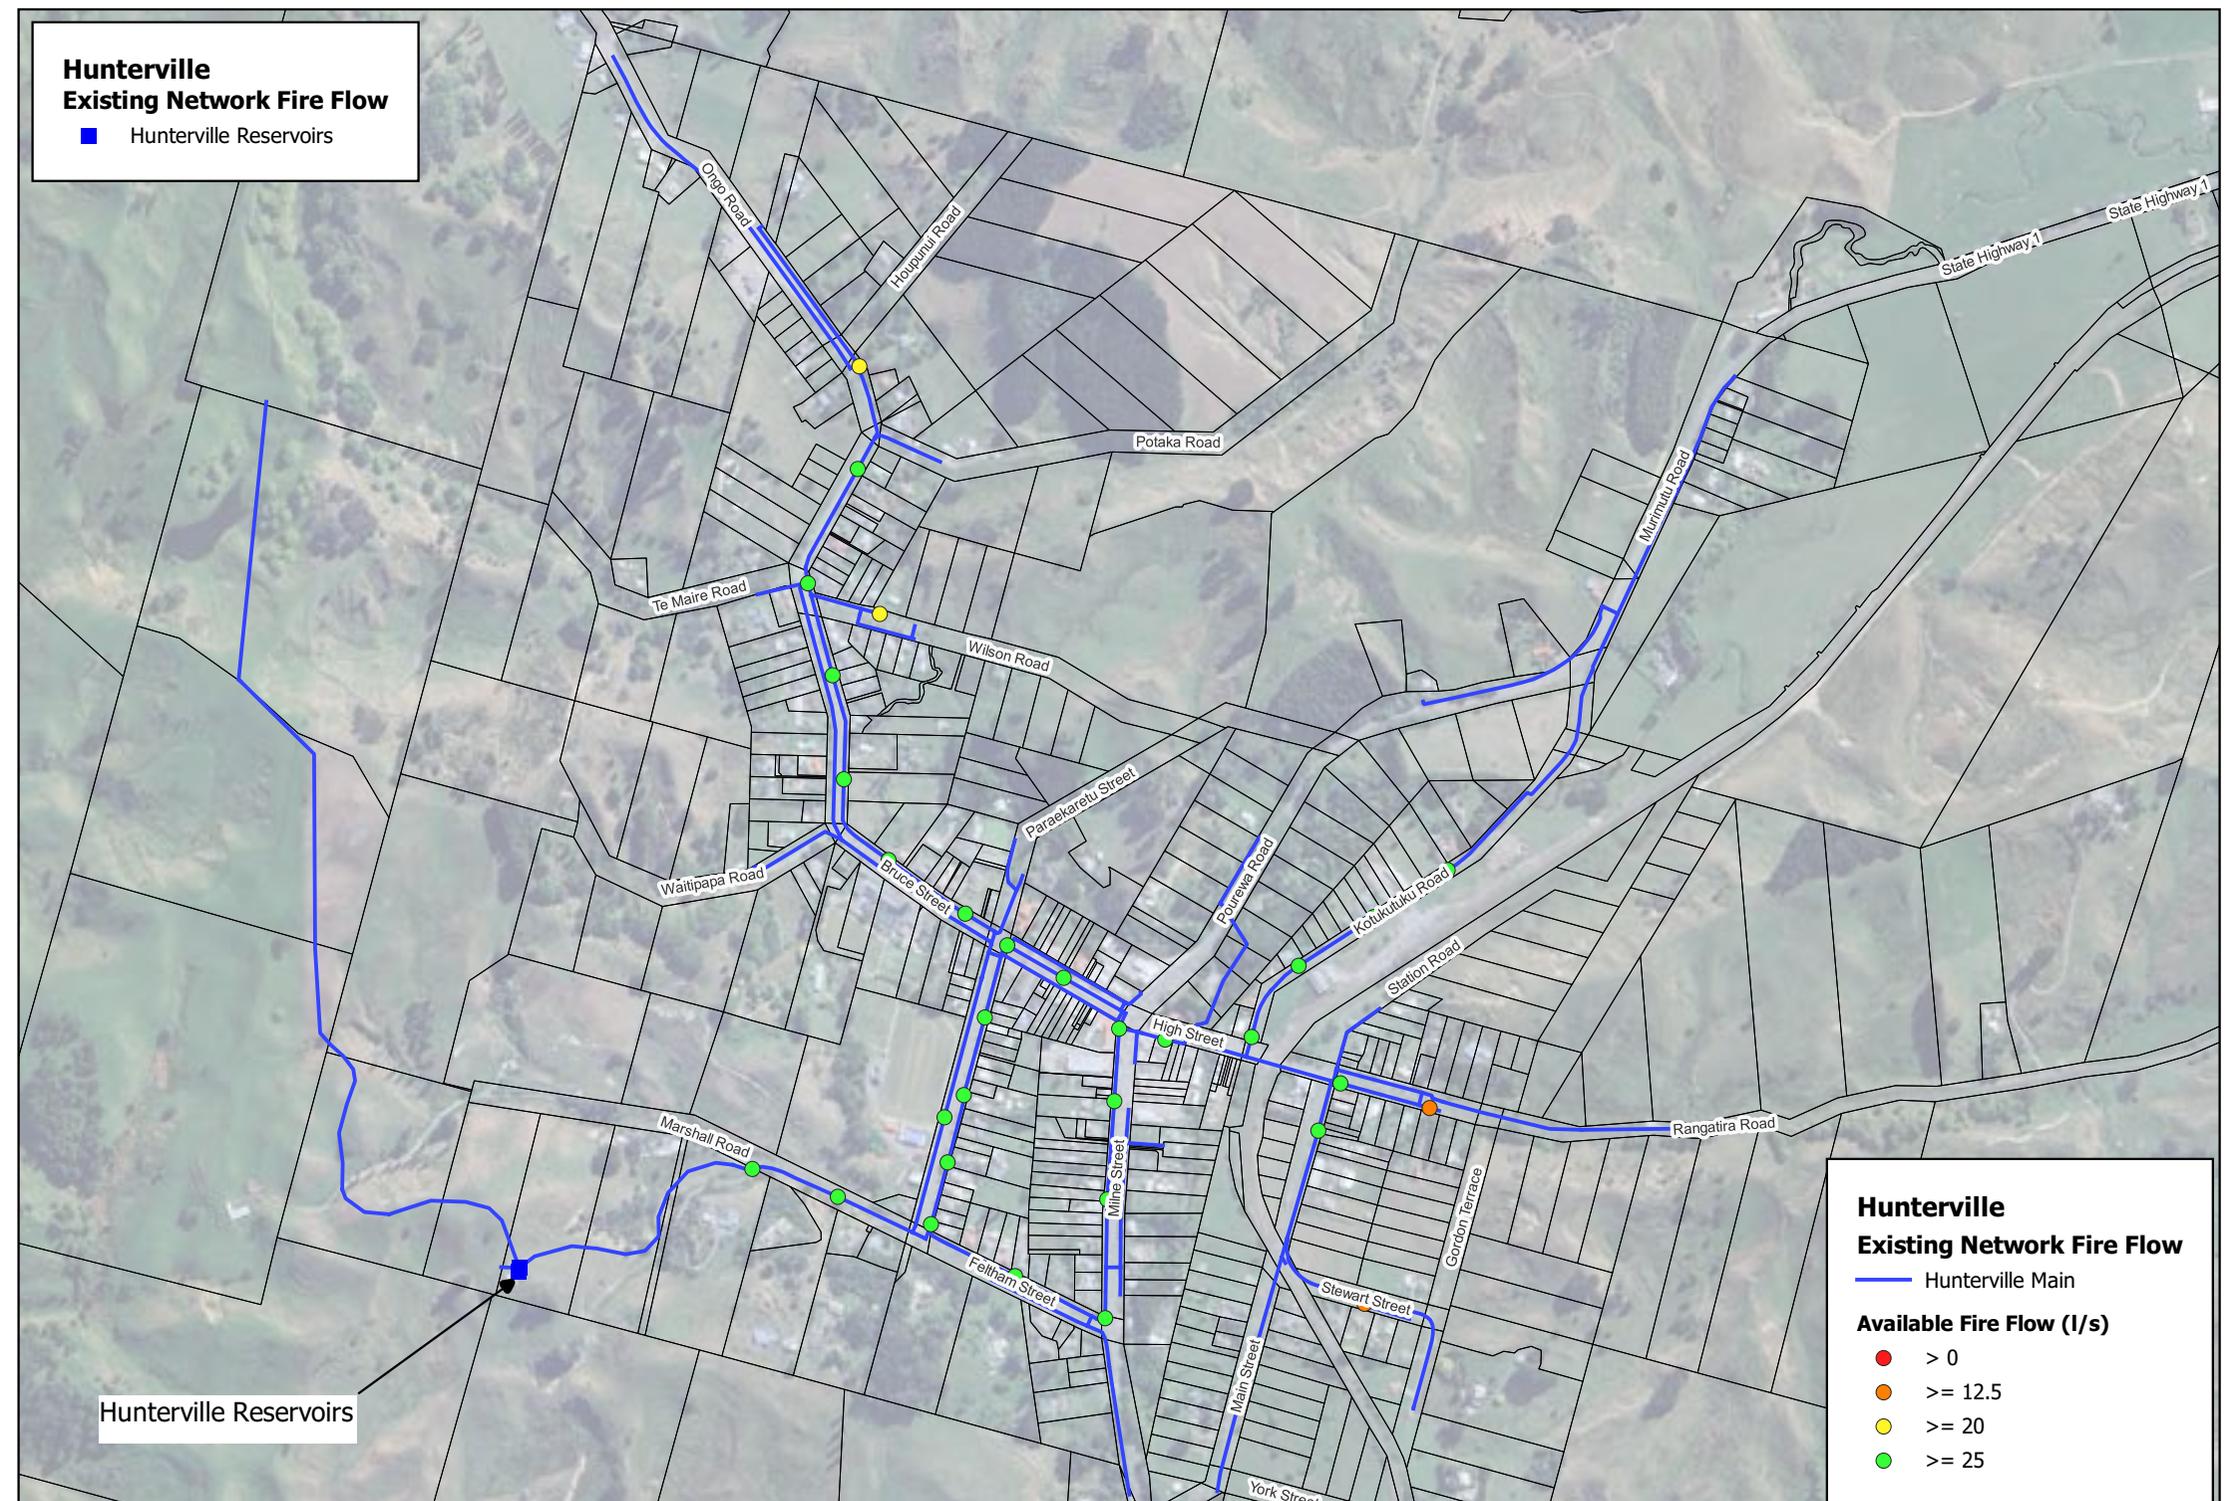

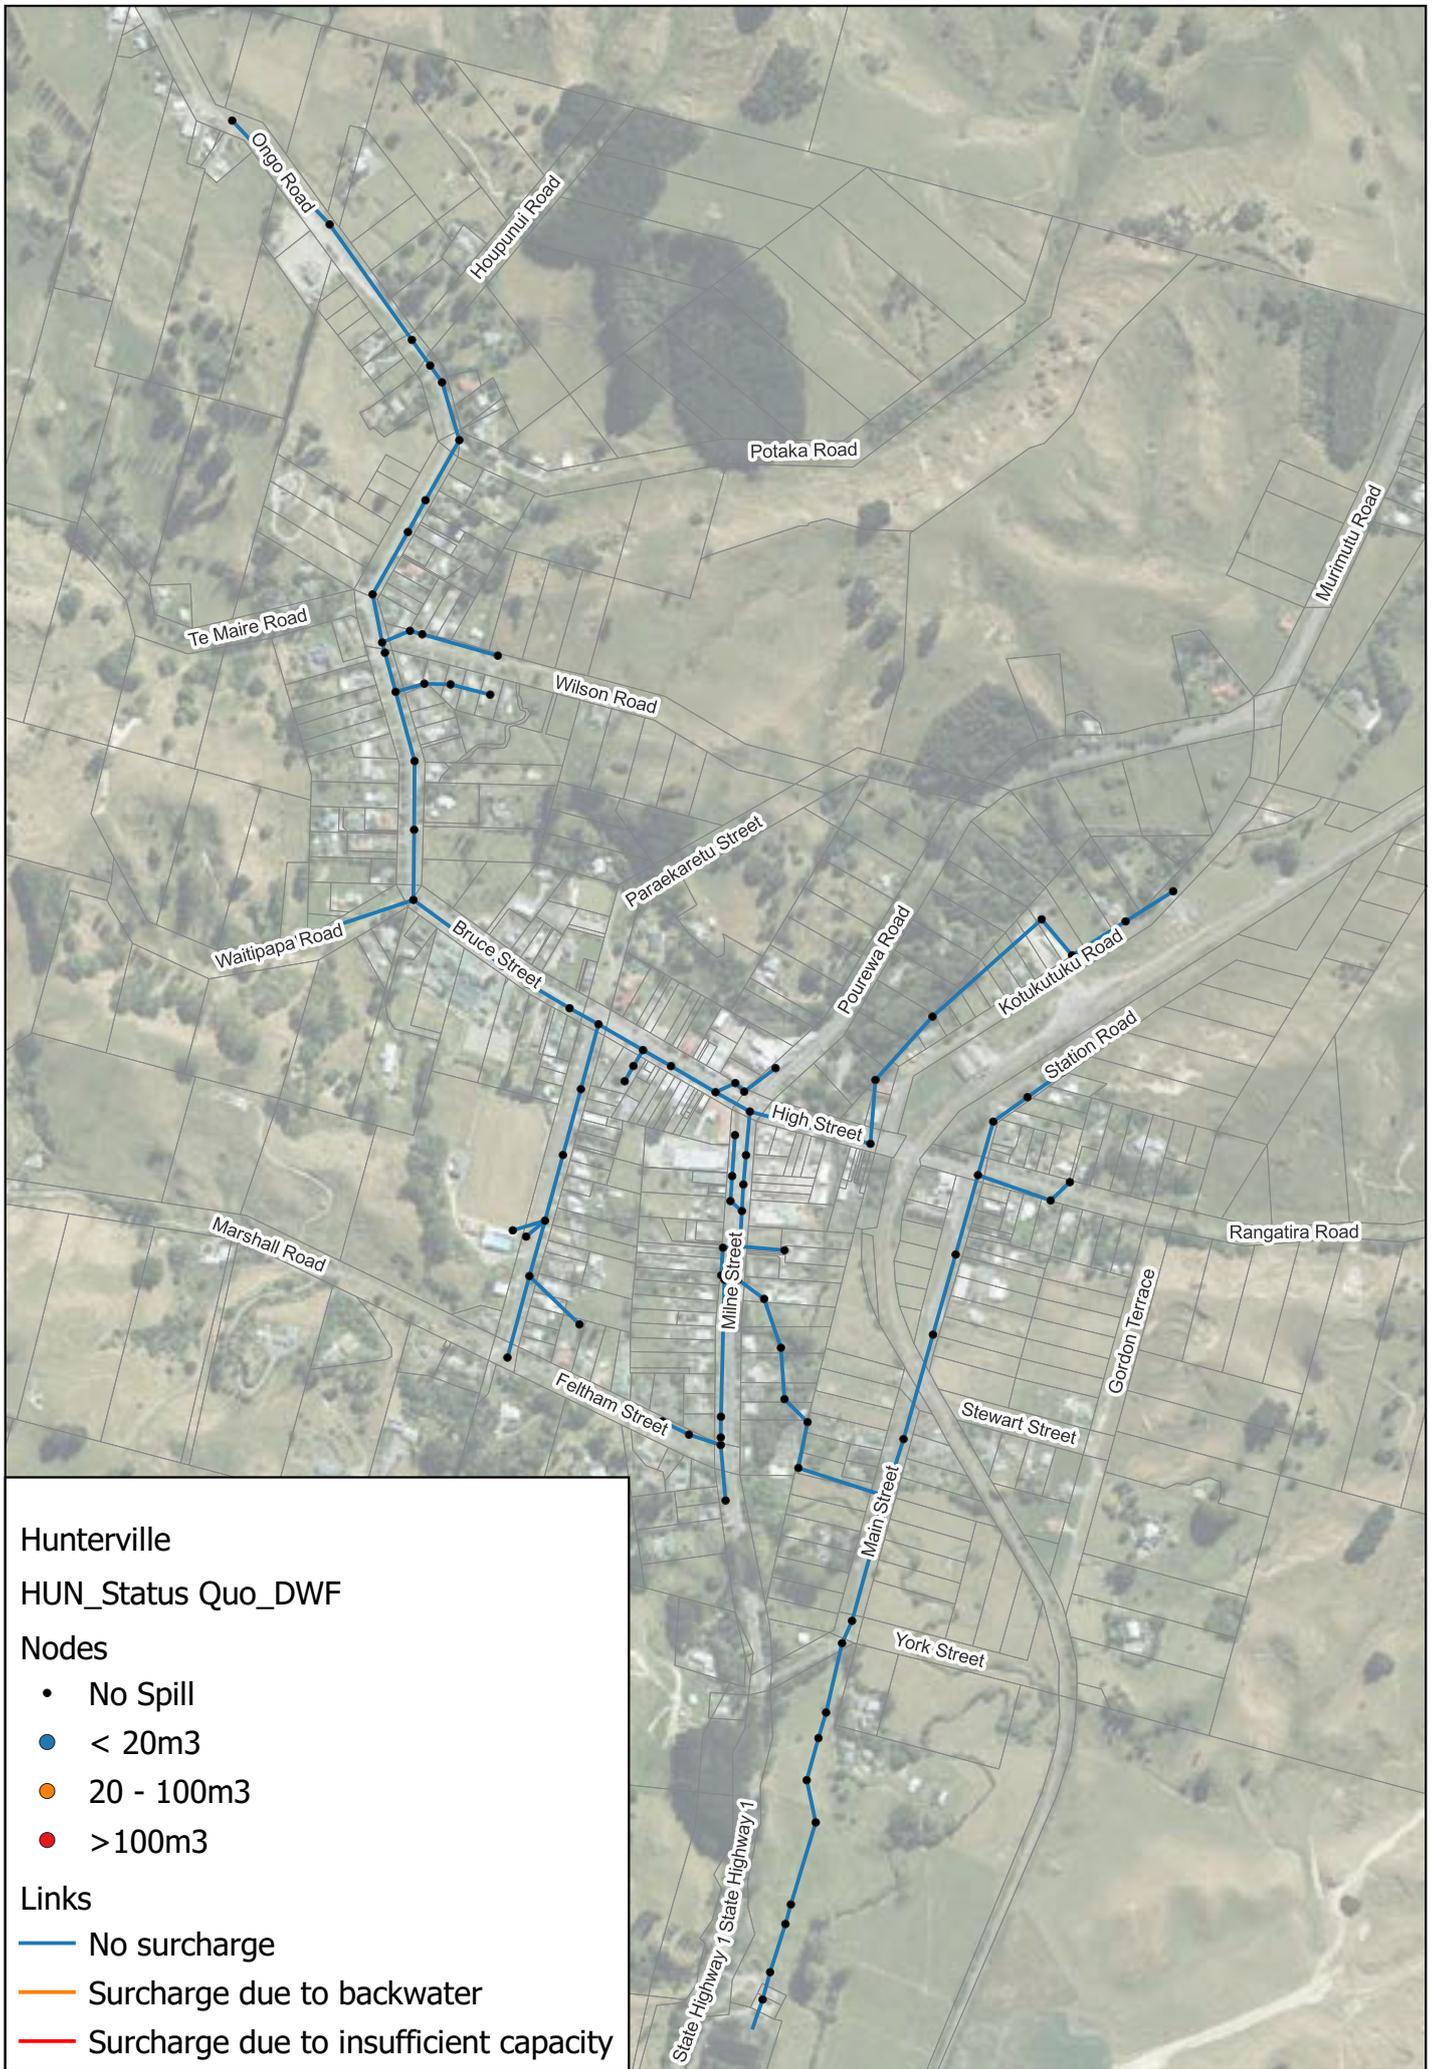

Hunterville

HUN_Status Quo_DWF

Nodes

- No Spill
- ● < 20m3
- ● 20 - 100m3
- ● > 100m3

Links

- No surcharge
- Surcharge due to backwater
- Surcharge due to insufficient capacity

